



- NOTES:**
- 1.) WHILE INSTALLING NEW SEWER MAINS, THE PROPOSED SEWER SHALL REMAINED PLUGGED TO PREVENT INFILTRATION TO EXISTING SEWER UNTIL ACCEPTED BY WCWD.
 - 2.) NO MORE THAN TWO CONCRETE GRADE RINGS SHALL BE USED UNDER CAST IRON FRAME.
 - 3.) INSTALL A-LOK PREMIUM GASKETS ON NEW CONSTRUCTION. INSTALL FLEXIBLE PIPE-TO-MANHOLE CONNECTOR WITH STAINLESS STEEL WEDGE STYLE BAND WHEN TYING TO EXISTING MANHOLES.
 - 4.) FOR SEWER PIPES LARGER THAN 21" IN DIAMETER, COORDINATE MANHOLE DESIGN WITH WCWD.
 - 5.) IF STRUCTURES ARE PROPOSED TO BE INSTALLED IN DISTURBED SOIL, COORDINATE WITH WCWD FOR DESIGN TO PREVENT SETTLING ISSUES.
 - 6.) IF MANHOLE IS INSTALLED IN A ROADWAY, BACKFILL WITH 100% CRUSHED STONE.
 - 7.) FOR A CUT IN MANHOLE, INSTALL COORDINATE COUPLING SELECTION AND INSTALLATION WITH WCWD.

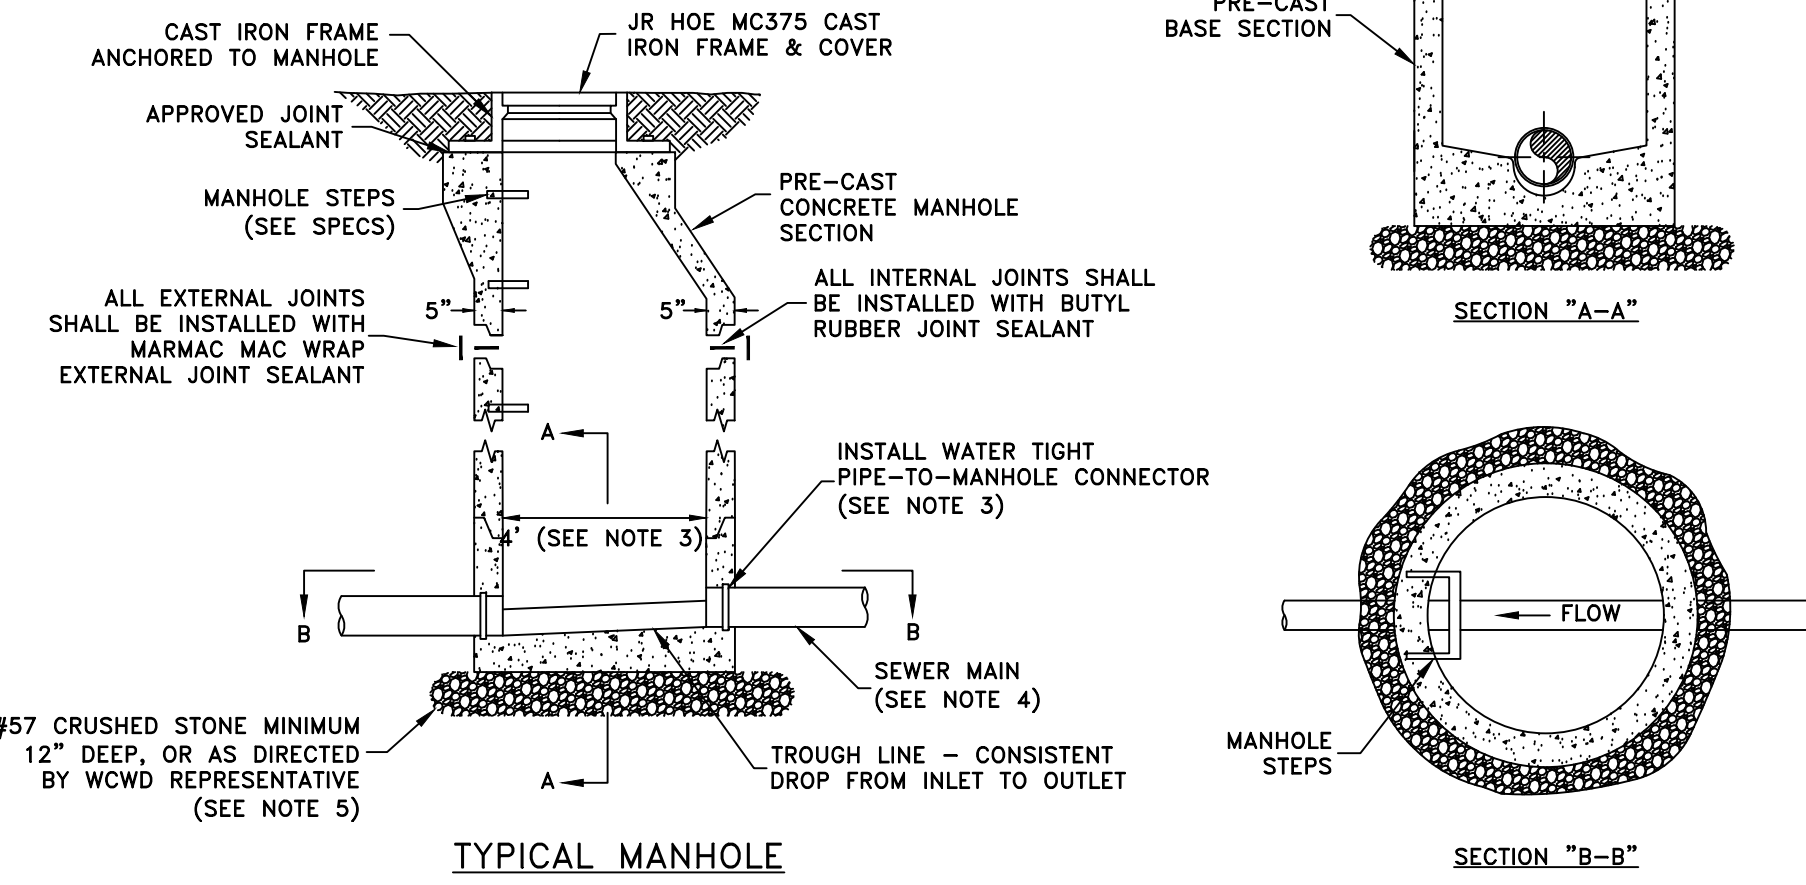


TYPICAL MANHOLE


- NOTES:**
- 1.) WHILE INSTALLING NEW SEWER MAINS, THE PROPOSED SEWER SHALL REMAINED PLUGGED TO PREVENT INFILTRATION TO EXISTING SEWER UNTIL ACCEPTED BY WCWD.
 - 2.) FOR NEW CONSTRUCTION, ALL PRECAST STRUCTURES SHALL MEET ASTM C-478.
 - 3.) FOR FIELD FABRICATED EXTERNAL DROP CONNECTIONS:
FORCE MAIN CONNECTIONS: ALL FITTINGS SHALL BE FBE COATED DUCTILE IRON GRAVITY SEWER: GASKETED PVC FITTINGS MAY BE UTILIZED.
 - 4.) INSTALL A-LOK PREMIUM GASKETS ON NEW CONSTRUCTION. INSTALL FLEXIBLE PIPE-TO-MANHOLE CONNECTOR WITH STAINLESS STEEL WEDGE STYLE BAND WHEN TYING TO EXISTING MANHOLES.
 - 5.) WHEN CONNECTING FORCE MAIN INTO A MANHOLE, CORROSION PREVENTION COATING SHALL BE INSTALLED ON THE CONNECTING MANHOLE AND THE NEXT TWO DOWNSTREAM MANHOLES OR AS DIRECTED BY WCWD.
 - 6.) IF STRUCTURES ARE PROPOSED TO BE INSTALLED IN DISTURBED SOIL, COORDINATE WITH WCWD FOR DESIGN TO PREVENT SETTLING ISSUES.
 - 7.) IF MANHOLE IS INSTALLED IN A ROADWAY, BACKFILL WITH 100% CRUSHED STONE.

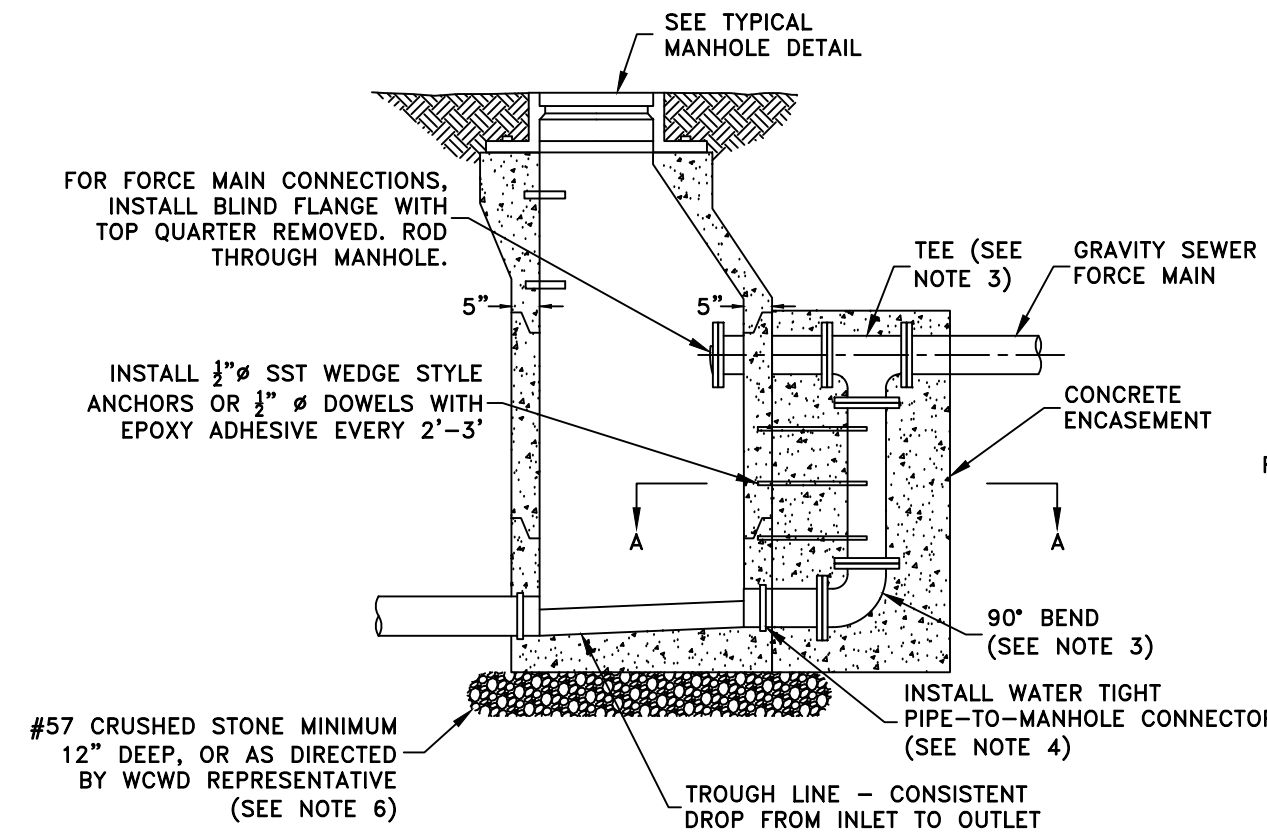


EXTERNAL DROP MANHOLE
(FOR USE WHERE SPECIFIED ON PLANS)

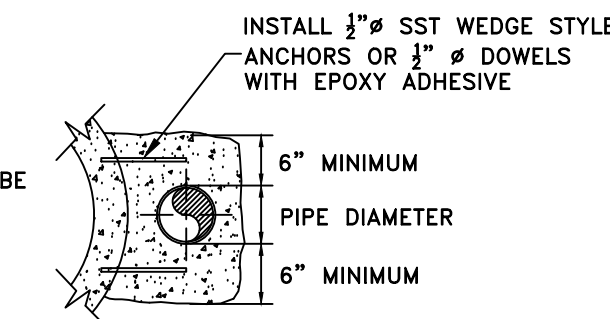

SECTION "A-A"

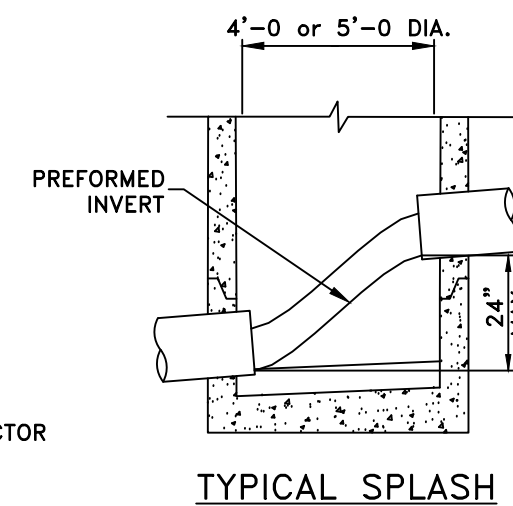


TYPICAL SPLASH

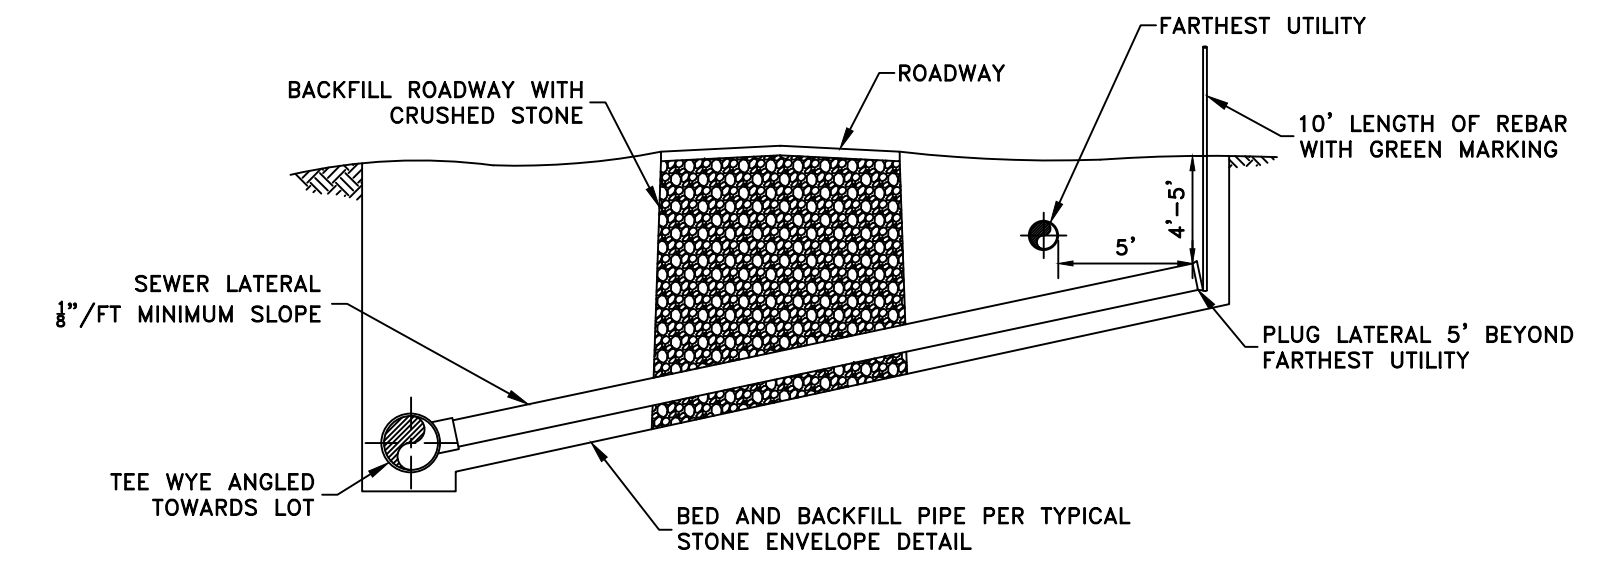


TYPICAL SEWER SERVICE
LATERAL "LONG SIDE"

- NOTES:**
- 1.) WHEN INSTALLING SEWER MAIN UNDER A ROADWAY, PIPE SHOULD BE BACKFILLED WITH 100% #9M OR #57 STONE TO SUBGRADE OR BY 48" OF #9M OR #57 STONE AND COMPACTED SOIL TO SUBGRADE IF APPROVED BY CCP.

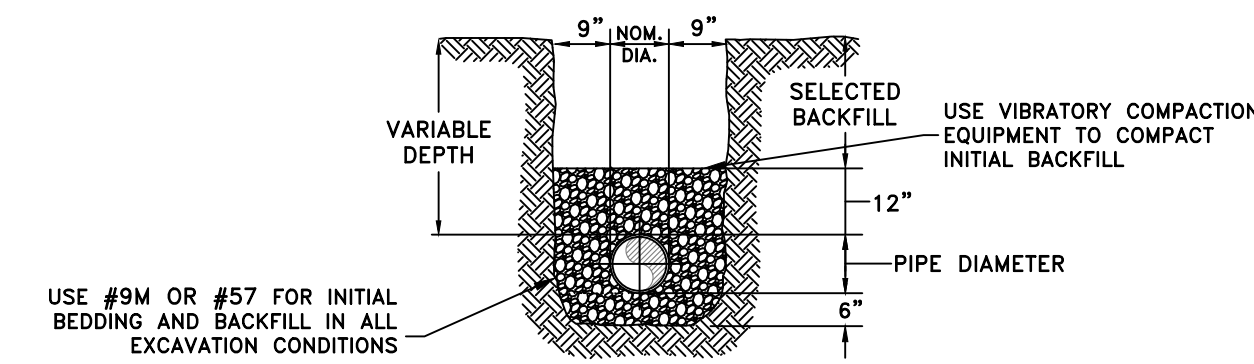


TYPICAL STONE ENVELOPE - SEWER


- NOTES:**
- 1.) WHEN INSTALLING FORCE MAIN UNDER A ROADWAY, PIPE SHOULD BE BEDDED AND BACKFILLED WITH 100% #9M OR #57 STONE TO SUBGRADE.

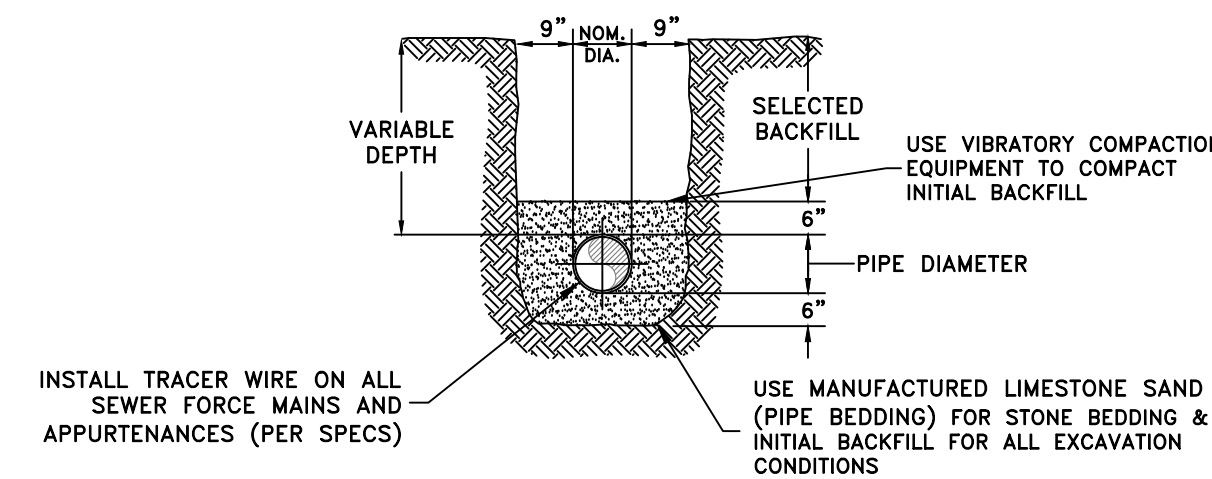

TYPICAL STONE ENVELOPE - FORCE MAIN

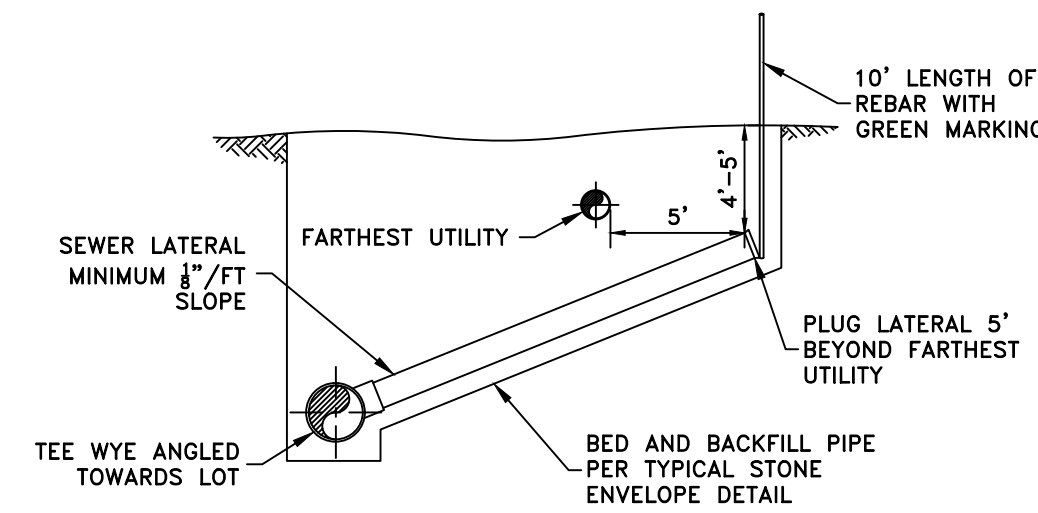


TYPICAL SEWER SERVICE
LATERAL "SHORT SIDE"

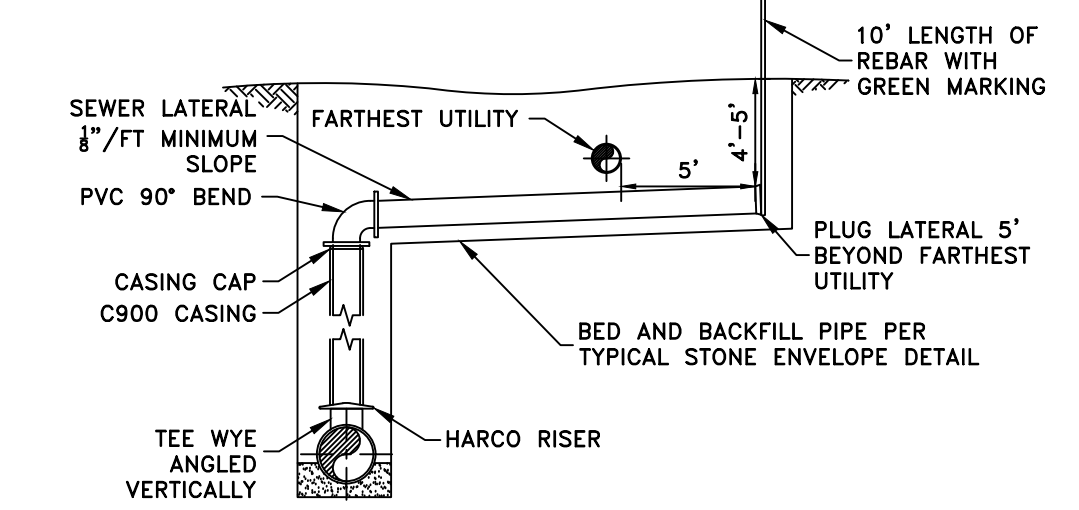


DEEP SEWER SERVICE
DETAIL

- NOTES:**
- 1.) IF A VERTICAL SEPARATION OF 18" CANNOT BE ACHIEVED BETWEEN ANY TWO UTILITY CROSSINGS DUE TO SITE CONSTRAINTS, STEEL OR PVC CASING SHALL BE UTILIZED DOWN TO A MINIMUM SEPARATION OF 6". THE LENGTH OF CASING SHALL BE ADEQUATE TO SPAN THE TRENCH OF THE UTILITY BEING CROSSED. SPACERS AND END CAPS ARE NOT NECESSARY, BUT THE ENDS OF THE CASING SHOULD BE SEALED WITH SPRAY FOAM.

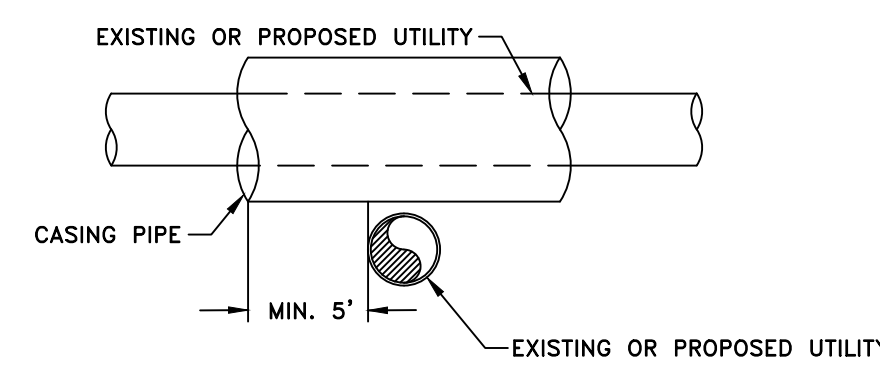


TYPICAL UTILITY CROSSING

- NOTES:**
- 1.) FOR BOTH CONCRETE AND ASPHALT PAVEMENT REPAIR, REFERENCE BOWLING GREEN PUBLIC WORKS STREET REPAIR METHOD DETAIL OR COORDINATE WITH GOVERNING ROAD AGENCY.
 - 2.) FOR CONCRETE PAVEMENT, REPLACE WITH A CONTINUOUS SLAB FROM SUB-BASE TO SURFACE.

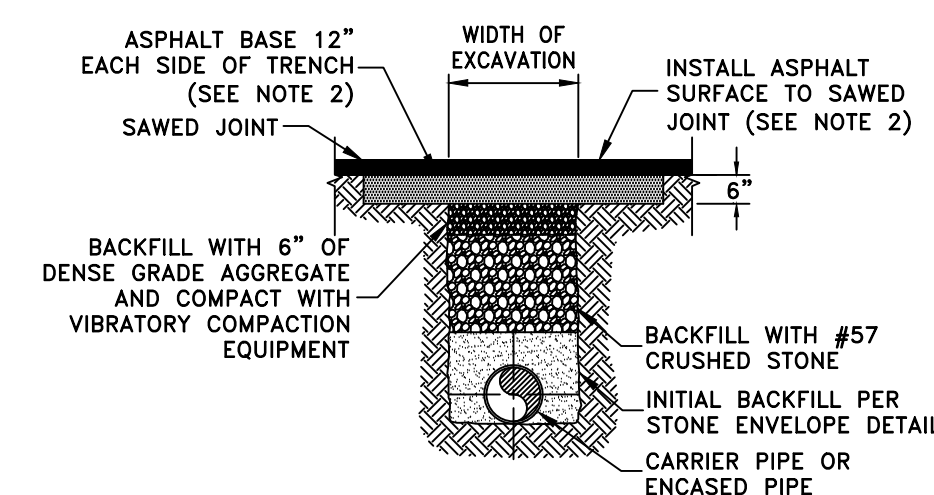


SURFACE RESTORATION
(FOR CROSSING OF ALL STREETS & HIGHWAYS)

- NOTES:**
- 1.) VALVE INSTALLATIONS SHALL BE BEDDED AND BACKFILLED WITH CRUSHED STONE.

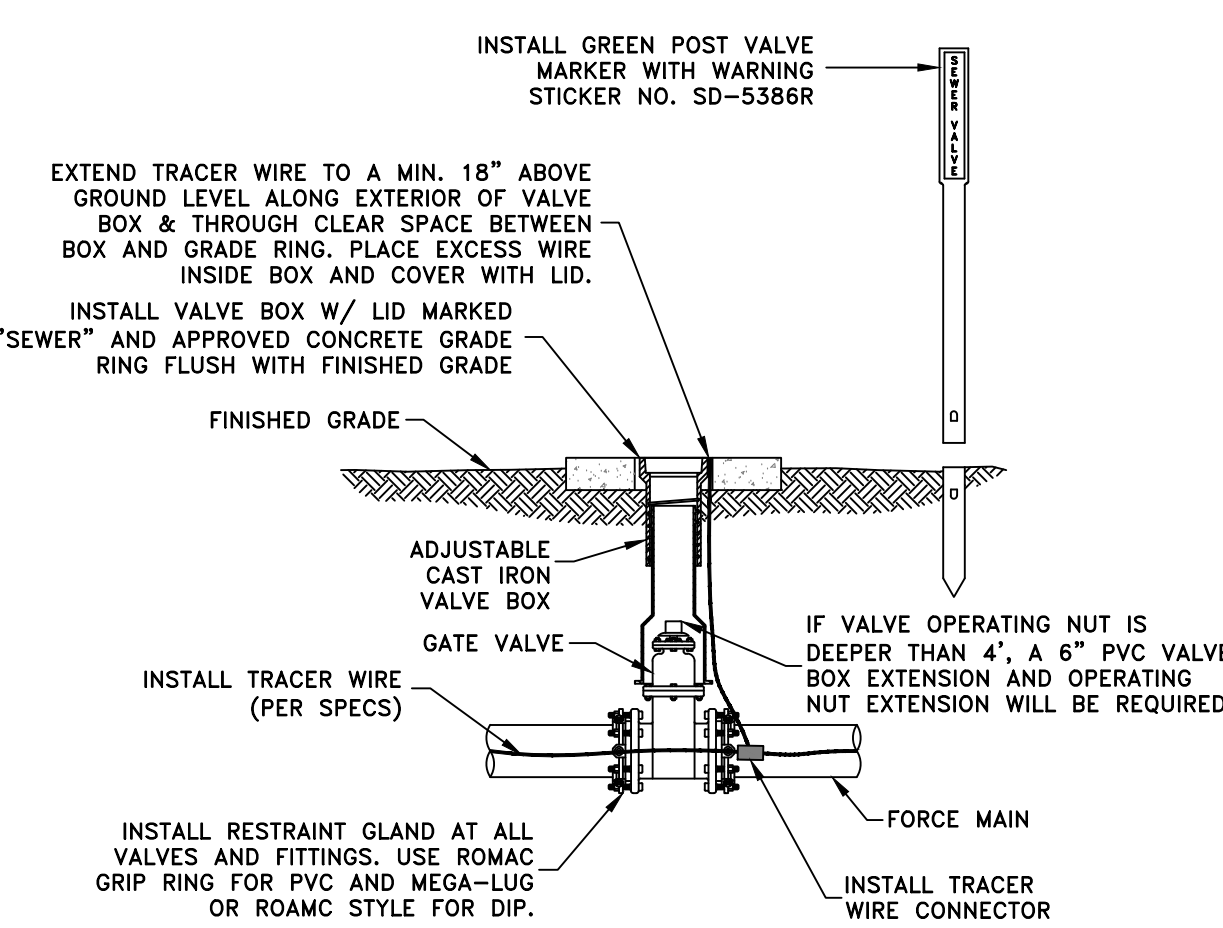

TYPICAL IN-LINE VALVE
INSTALLATION

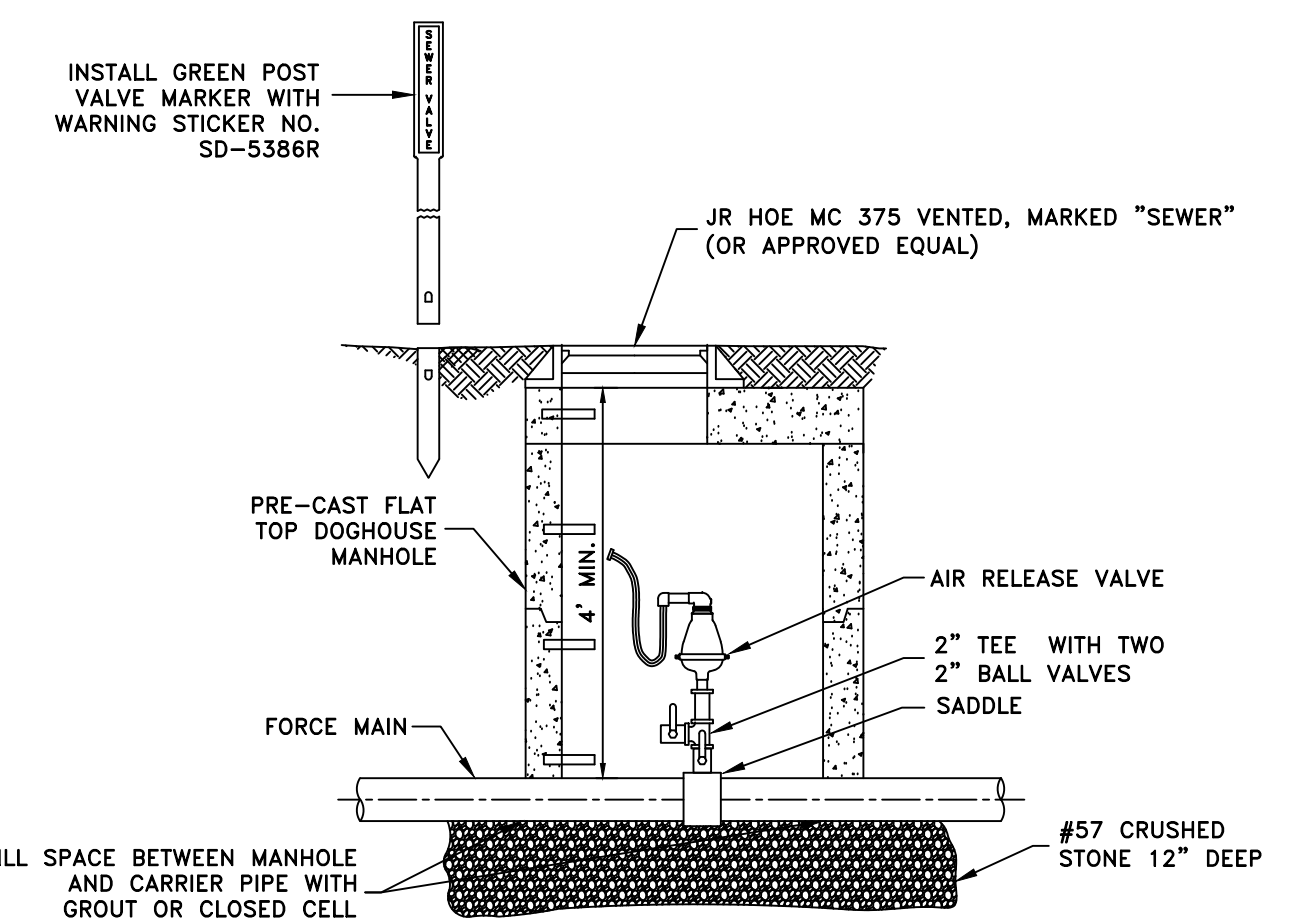

STANDARD AIR RELEASE
STATION - FORCE MAIN

SCALE: NOT TO SCALE

DATE: 03-06-2026

DWG NO.: SD1

DESIGNED: WCWD

DRAWN: BCP


CHECKED: CRH

REVISIONS:


NO.: DATE:

DRAWING:



SD1

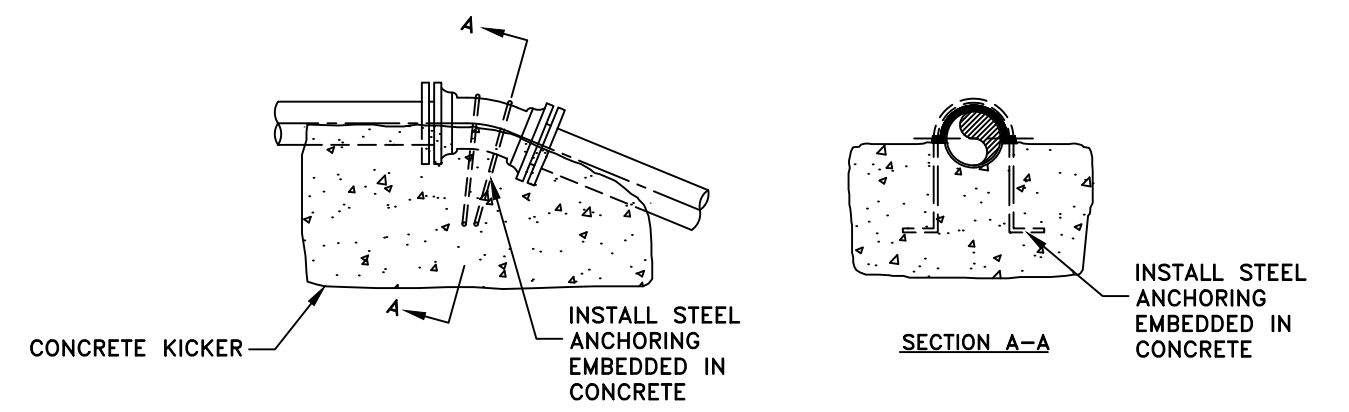

VERTICAL BEND PIPE ANCHOR DETAIL

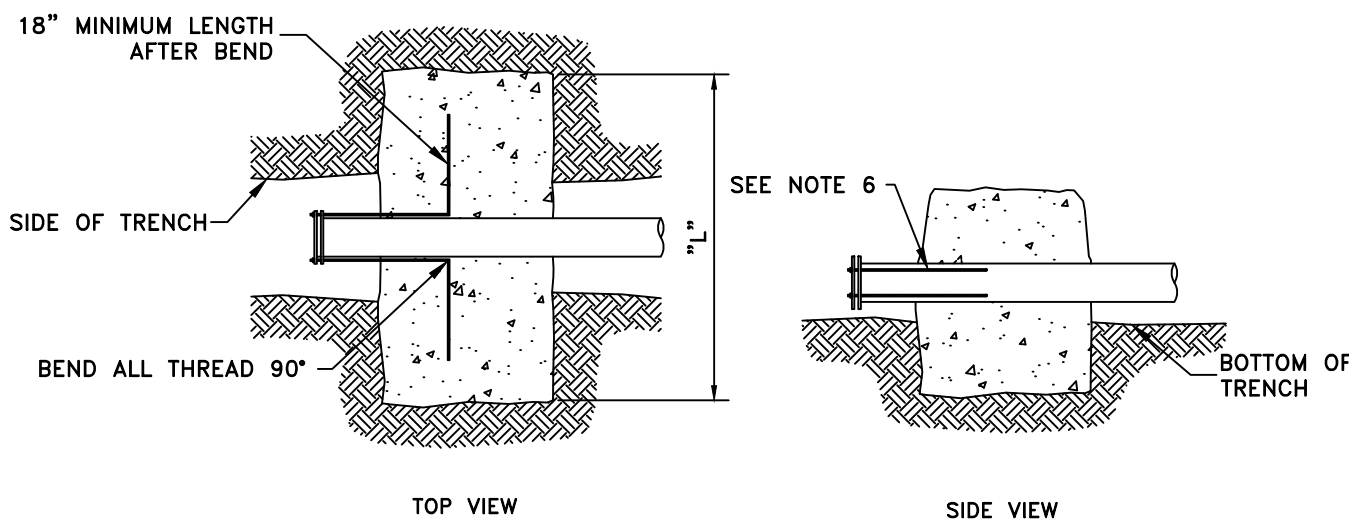

CONCRETE REVERSE KICKER (DEADMAN) DETAIL

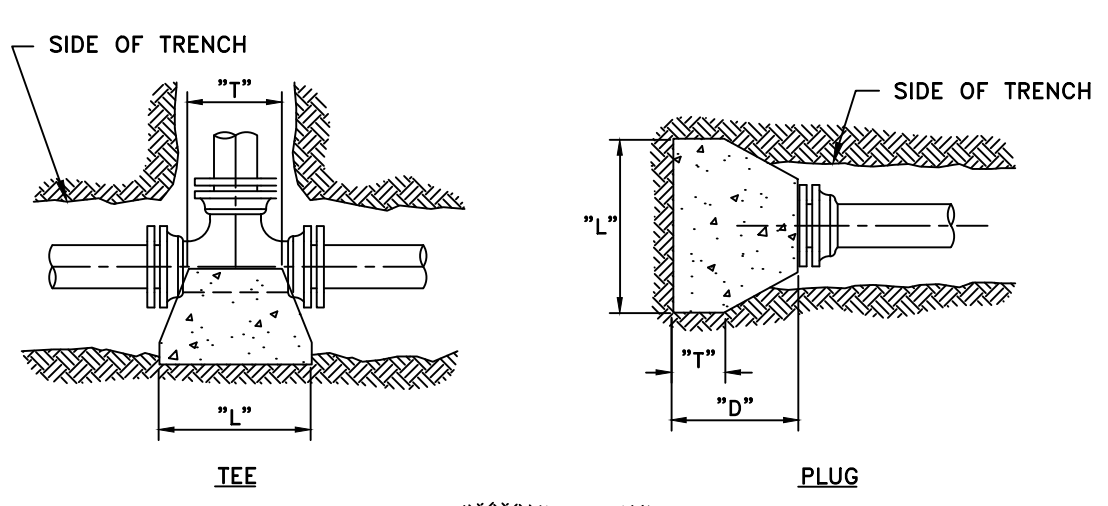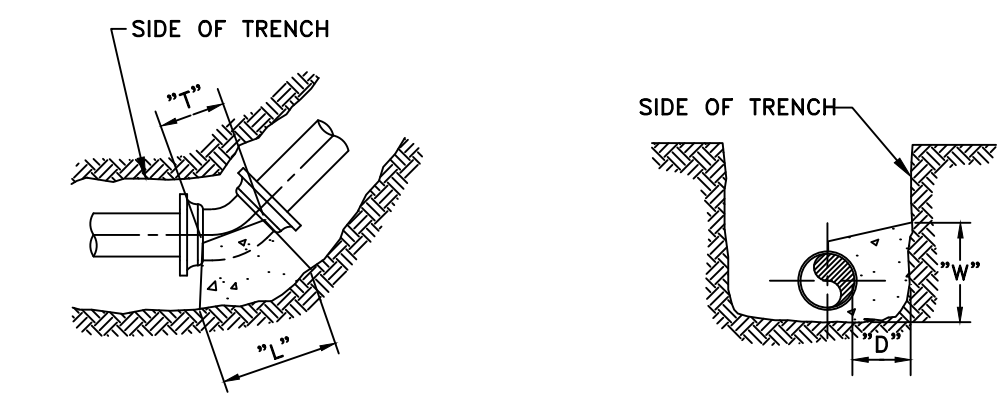

VALVES AT END OF LINE

- NOTES:
- ALL FITTINGS SHALL BE EPOXY COATED
 - ALL FITTINGS SHALL INCLUDE ROMAC RESTRAINT GLAND AND GRIP RINGS.
 - CONCRETE THRUST BLOCKS TO BE POURED AGAINST UNDISTURBED EARTH. PLASTIC BARRIER SHALL BE PLACED BETWEEN ALL CONCRETE AND PIPE AND/OR FITTINGS.
 - ANCHOR BAR SHALL BE 5/8" MINIMUM DIAMETER.
 - RODDING FOR A CONCRETE REVERSE KICKER SHALL BE AS FOLLOWS: ≤4" USE 2 RODS, 6"-10" USE 4 RODS & ≥12" PER ENGINEER.
 - FITTINGS SHALL BE INSTALLED AS REQUIRED PER WCWD INSPECTOR.


90° BENDS												
SIZE	2	4	6	8	10	12	14	16	18	20	24	30
"D"	6	8	8	10	12	14	22	22	24	24	30	30
"L"	16	20	24	30	32	34	68	68	80	80	96	120
"W"	8	10	12	18	22	24	34	40	40	48	60	60
"T"	10	12	16	20	22	22	38	38	40	40	44	52

45° BENDS												
SIZE	2	4	6	8	10	12	14	16	18	20	24	30
"D"	6	6	8	10	12	12	22	22	24	24	30	30
"L"	14	18	18	22	24	24	51	51	60	60	72	90
"W"	8	10	12	16	18	18	25	25	29	29	36	44
"T"	10	12	16	18	18	18	38	38	40	40	44	52


22 1/2" & 11 1/4" BENDS												
SIZE	2	4	6	8	10	12	14	16	18	20	24	30
"D"	6	10	14	18	20	20	22	22	24	24	30	30
"L"	20	24	28	28	28	28	36	36	42	42	54	66
"W"	18	20	22	24	24	24	18	18	21	21	24	31
"T"	12	14	16	18	18	18	38	38	40	40	44	52

TEES, PLUGS & BLOWOFFS												
SIZE	2	4	6	8	10	12	14	16	18	20	24	30
"D"	12	16	18	24	28	30	30	30	30	30	36	36
"L"	12	16	18	24	28	30	60	60	72	72	84	102
"W"	14	16	18	18	22	24	28	28	32	32	40	51
"T"	10	10	12	12	12	12	38	38	40	40	44	52

MINIMUM CONCRETE BLOCKING FOR PIPE & FITTINGS

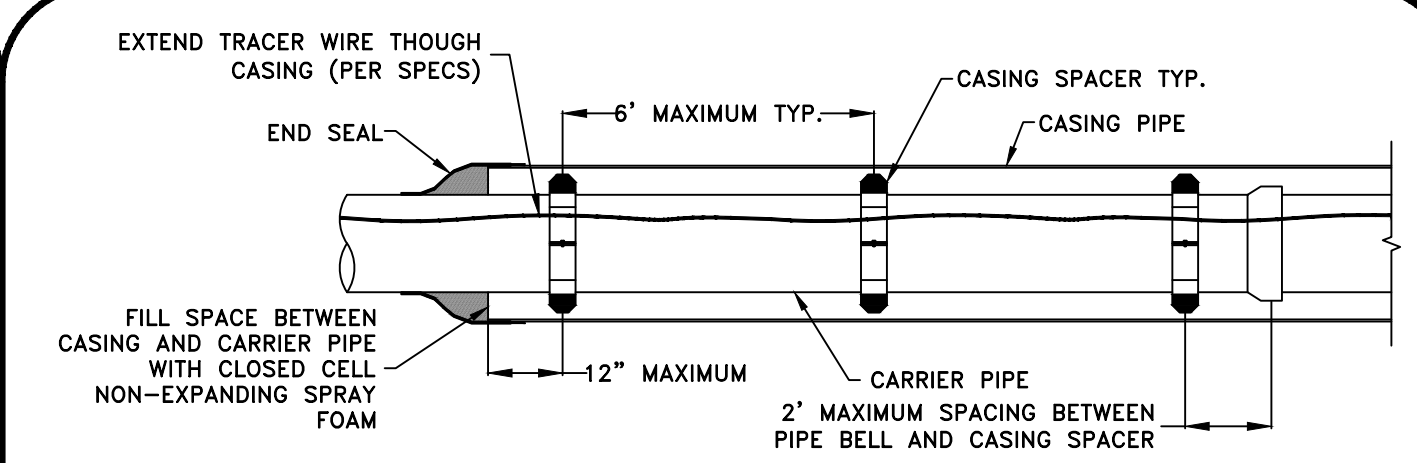

CASING SIDE VIEW DETAIL

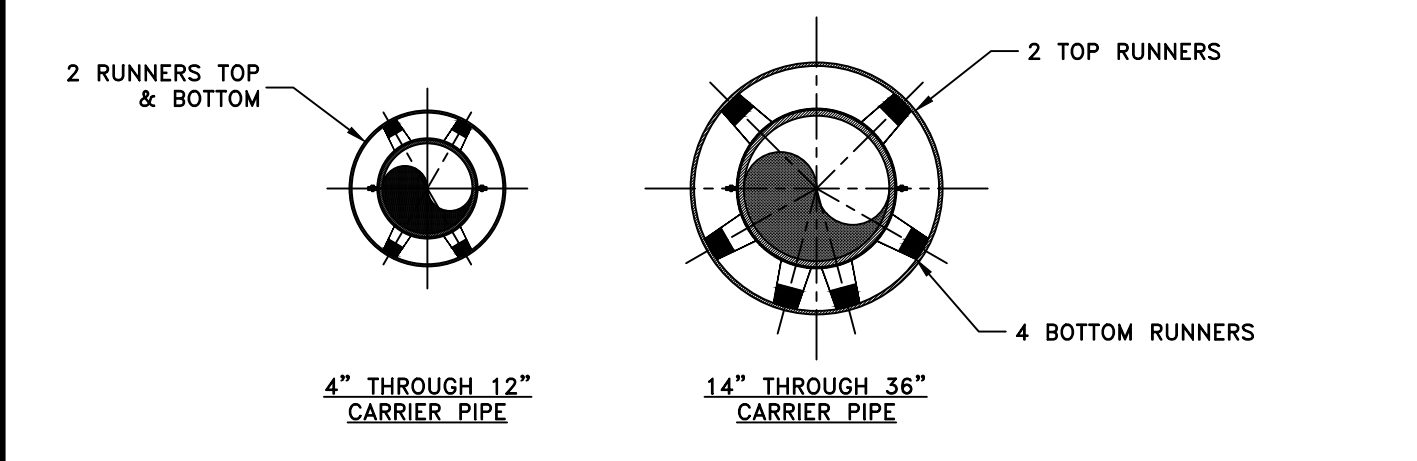

CASING END VIEW DETAIL



CARRIER TYPE AND CASING PIPE SIZES (MIN) IN INCHES												
CARRIER PIPE NOM. DIA. (D1)	4	6	8	10	12	15	16	18	20	21	24	30
CASING PIPE NOM. DIA. (D2)	12	12	16	16	20	22	24	24	24	30	36	42
WALL THICKNESS	0.375	0.375	0.375	0.375	0.375	0.500	0.500	0.500	0.500	0.500	0.500	0.625

CASING SCHEDULE


- NOTES:
- MINIMUM COVER AT LOWEST POINT IN RIGHT OF WAY SHOULD BE 4' TO TOP OF CASING WITHIN KYTC AND COUNTY ROADWAY RIGHT-OF-WAY AND 5' TO TOP OF CASING WITHIN RAILROAD RIGHT-OF-WAY.
 - ALL CASINGS SHALL EXTEND THROUGH RIGHT OF WAY.
 - THE INSIDE DIAMETER OF THE CASING PIPE SHALL BE A MINIMUM OF 4 INCHES GREATER THAN THE OUTSIDE DIAMETER OF THE CARRIER PIPE BELL OR COUPLING.
 - FOR CASINGS OVER 50 FEET IN LENGTH ON GRAVITY SEWER, ALL CARRIER PIPE SHALL BE UNRESTRAINED JOINT PVC PIPE. FOR CASINGS OVER 50 FEET IN LENGTH ON FORCE MAIN, ALL CARRIER PIPE SHALL BE RESTRAINED JOINT PVC PIPE.
 - STAINLESS STEEL SPACERS SHALL BE USED FOR ANY PIPE 12" IN DIAMETER AND LARGER.
 - PIPE TO BE USED AS A CASING SHALL CONFORM TO ASTM A252 STANDARD SPECIFICATION FOR WELDED & SEAMLESS STEEL PIPE PILES WITH A MINIMUM YIELD STRENGTH OF 35,000 PSI.

TYPICAL CASING DETAIL - SEWER & FORCE MAIN

- NOTES:
- VALVE INSTALLATIONS SHALL BE BEDDED AND BACKFILLED WITH CRUSHED STONE.
 - PRIVATE FORCE MAIN PUMP SHALL BE DESIGNED TO OVERCOME PRESSURE NEEDED TO OPEN BACKFLOW PREVENTER.
 - TAPPING SADDLE SIZE IS BASED ON THE DIAMETER OF THE PUBLIC FORCE MAIN, IF PRIVATE FORCE MAIN IS GREATER THAN 2" IN DIAMETER, CONSULT WITH WSB.

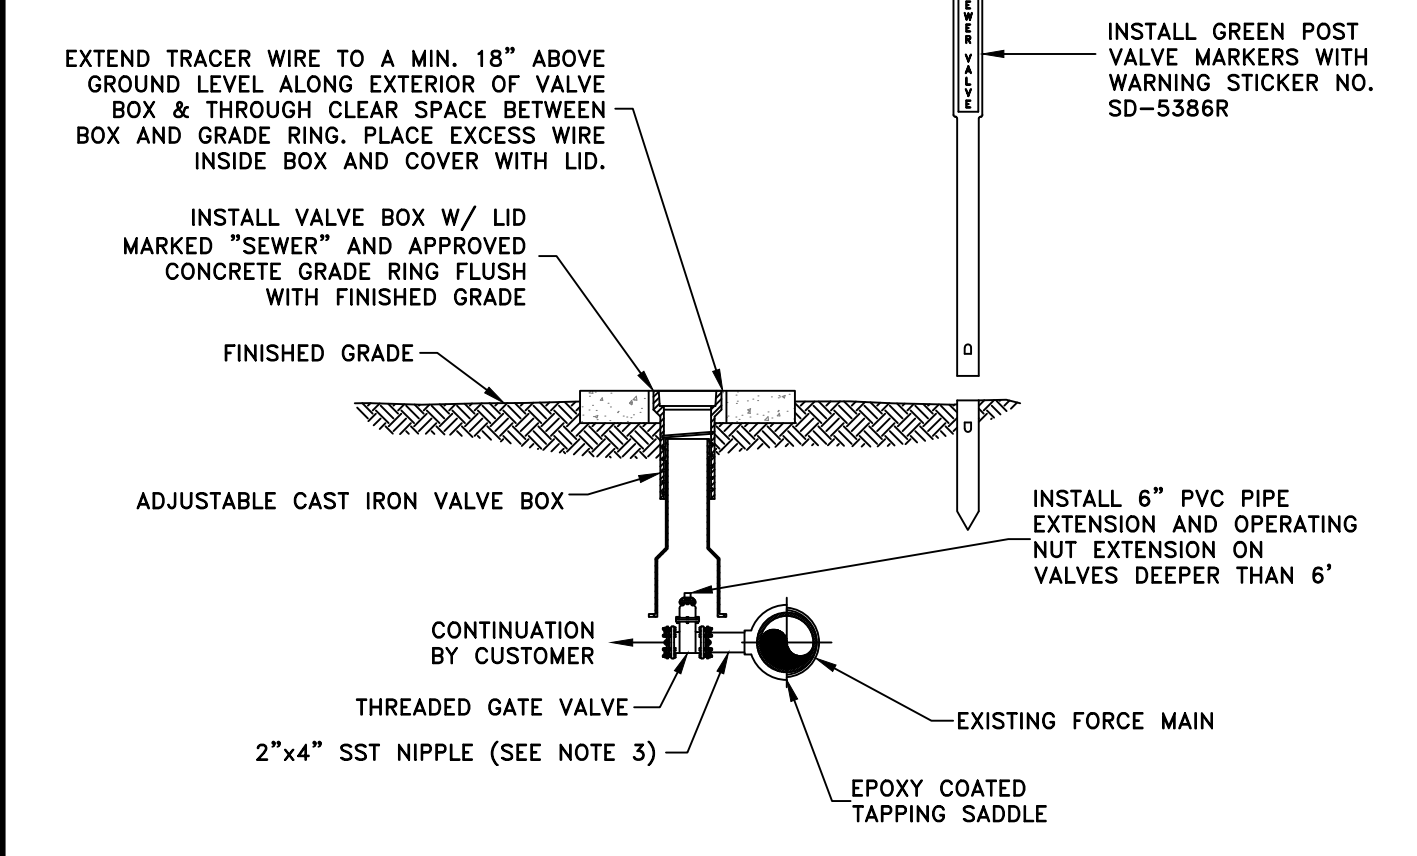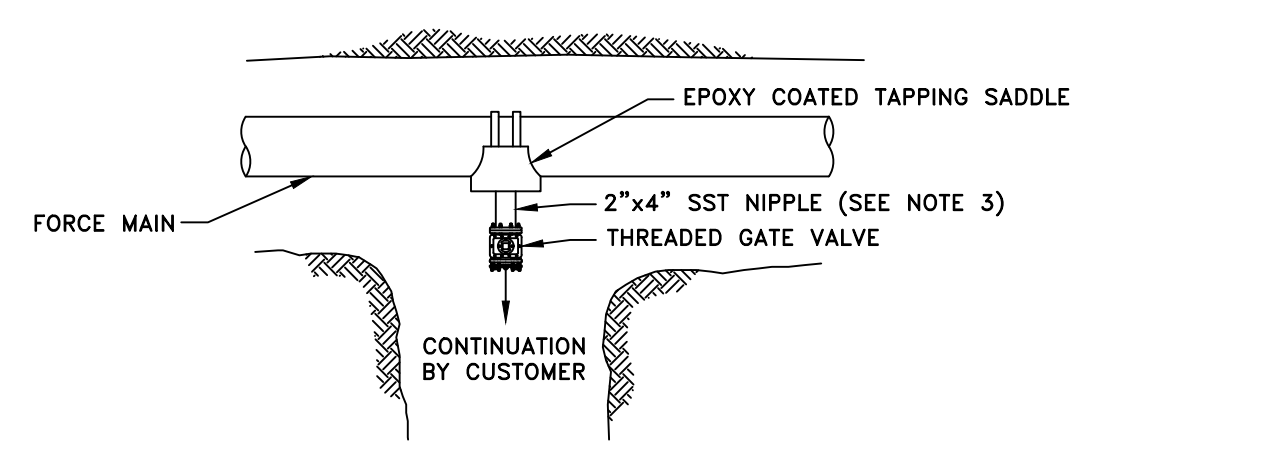


PRIVATE FORCE MAIN CONNECTION TO MAIN

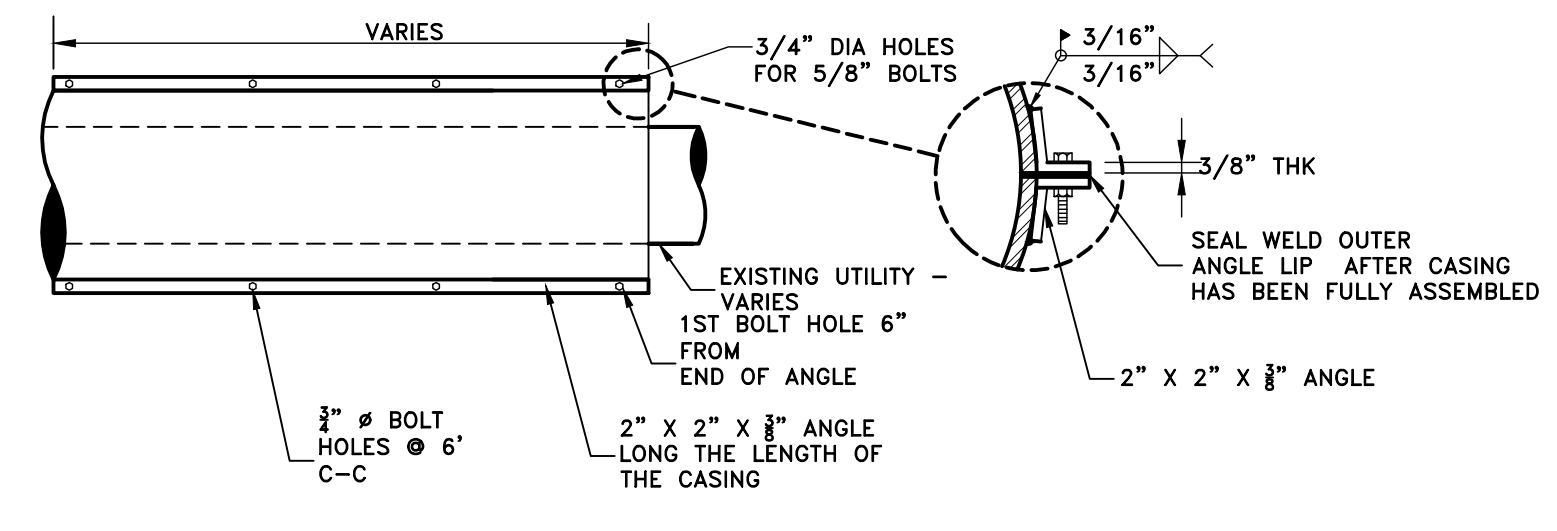


- NOTES:
- SPLIT CASINGS ARE INTENDED FOR OPEN CUT INSTALLATIONS ONLY AND PRIMARILY FOR PROTECTING EXISTING UTILITIES.
 - SPLIT CASING WILL NOT BE ACCEPTABLE FOR BORE AND JACK INSTALLATIONS.
 - CASING SPACERS SHALL BE PROVIDED AS SPECIFIED FOR TYPICAL CASING INSTALLATIONS.
 - SIZING AND SPACER CONFIGURATION PER TYPICAL CASING DETAIL.

TYPICAL SPLIT CASING DETAIL

- NOTES:
- WHILE INSTALLING NEW SEWER MAINS, THE PROPOSED SEWER SHALL REMAINED PLUGGED TO PREVENT INFILTRATION TO EXISTING SEWER UNTIL ACCEPTED BY WCWD.
 - INTERNAL DROP CONNECTIONS ARE NOT ALLOWED ON FORCE MAIN DIAMETERS GREATER THAN 2". FOR LARGER FORCE MAIN CONNECTIONS, REFER TO EXTERNAL DROP MANHOLE DETAIL.
 - IF THE MANHOLE BEING CORED IS DOWNSTREAM OF ANOTHER MANHOLE, TIE THE INTERNAL DROP INTO THE STRUCTURE OFFSET RADIALLY FROM THE INLET PIPE AND GROUT BOTTOM OF MANHOLE TO INTERCEPT FLOW.

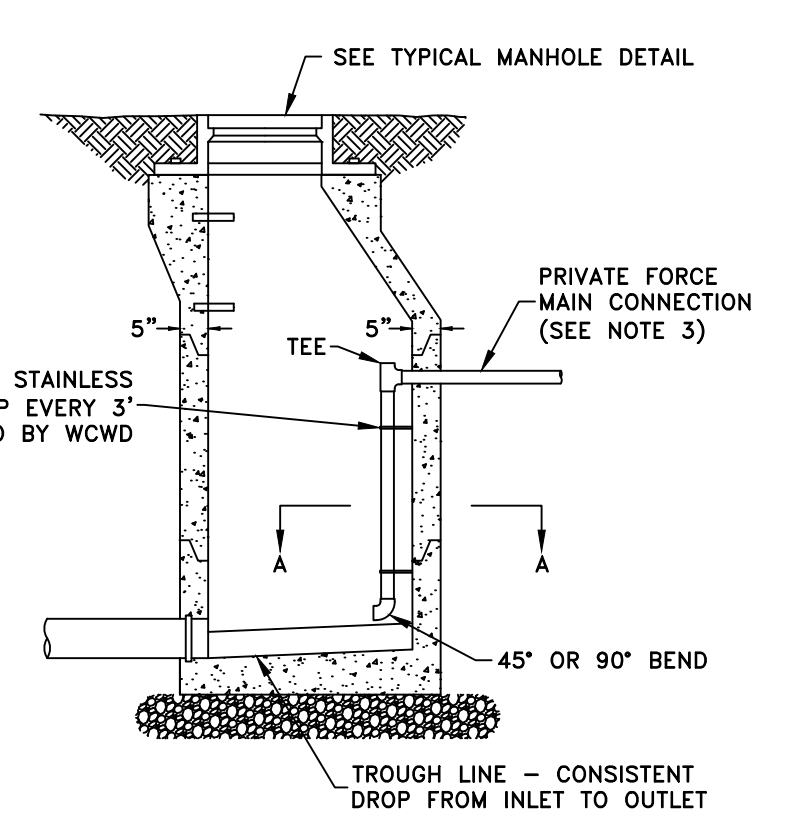


INTERNAL DROP MANHOLE (FOR USE WHERE SPECIFIED ON PLANS)

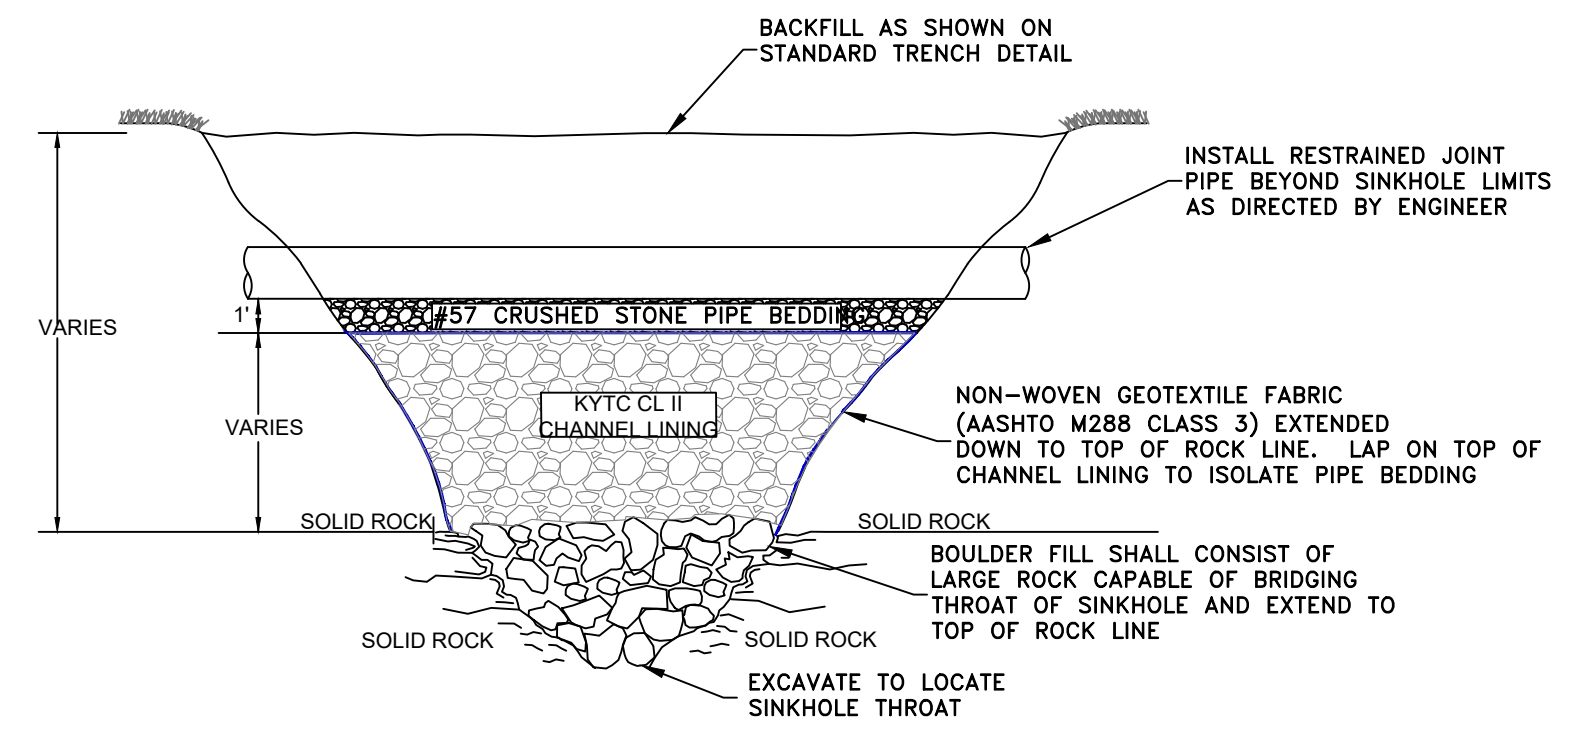

SINK HOLE REPAIR

- NOTES:
- ALTERNATIVELY, DIG DOWN THREE FEET INTO EXISTING SOIL AND POUR 3500 PSI CONCRETE UP TO 1' OF THE PROPOSED BOTTOM OF THE MANHOLE. USE #57 CRUSHED STONE TO ESTABLISH GRADE FOR STRUCTURE.

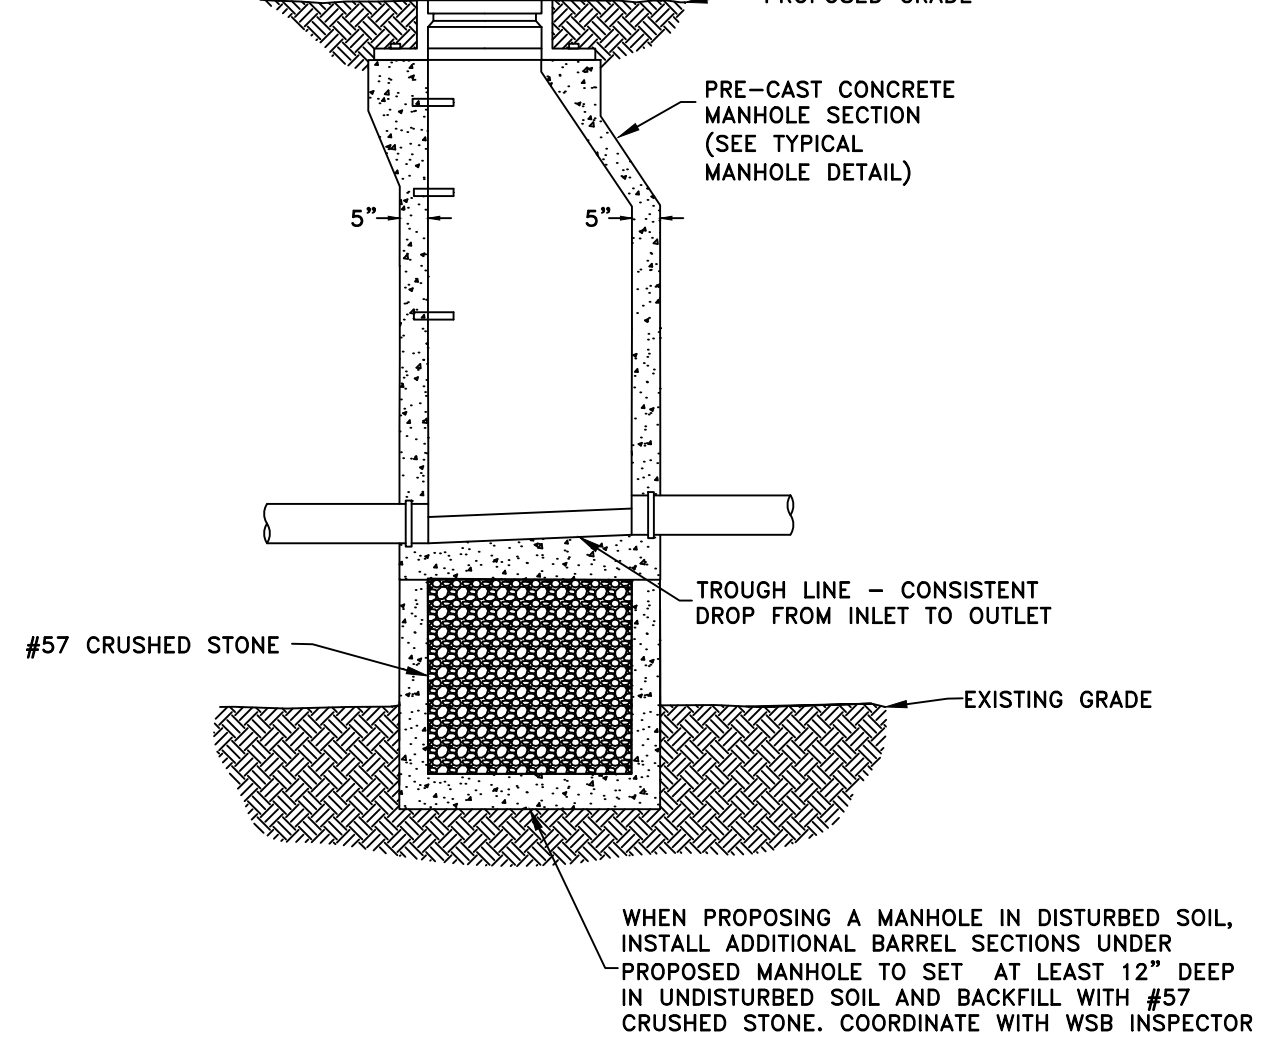

MANHOLE INSTALLED IN DISTURBED SOIL

SCALE: NOT TO SCALE

DATE: 03-06-2026

DWG NO.: SD2

DESIGNED: WCWD

DRAWN: BCP

CHECKED: CRH

REVISIONS:

NO.: DATE: